


Technical Selection

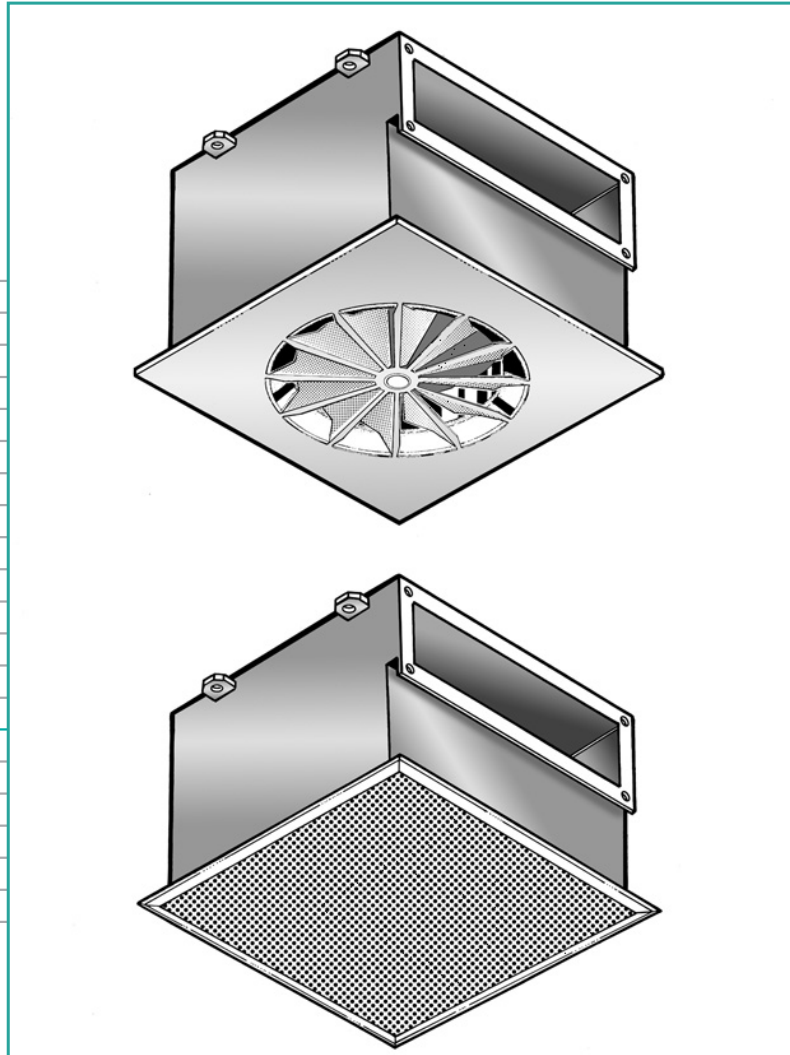

Puridrall and Puri-inlet
Air outlets for clean rooms

Preliminary remarks

Cleanroom classes 6 to 8 to DIN EN ISO 14644-1 (VDI 2083) or 1 000 to 100 000 to US Federal Standard 209 as well as C and D to EG-GMP are obtained using turbulent mixing-air flow. This is a mode of ventilation in which clean supply air entering the room is mixed - as intensively as possible - with the indoor air. The key effect on the degree of cleanliness is the dilution of air pollutants emitted in the room. The more even the dilution, the higher the degree of cleanliness reached.

This calls for air outlets that achieve intensive admixture of supply air and indoor air due to their induction effect. For this, KRANTZ KOMPONENTEN uses its own tried and tested twist outlets. Supply air discharge is horizontal and radial. The strong induction effect of the air jets causes a turbulent, diffuse mixing-air flow with constant, low indoor air velocity. This reliably prevents zones of higher particle concentration.

The Puridrall is made up of a twist outlet and a HEPA filter cell accommodated in a joint housing.

To filter return air directly at the collection point in clean rooms KRANTZ KOMPONENTEN provides the Puri-inlet. This has the same shape and quality as the Puridrall. Instead of a twist outlet element, the Puri-inlet has a perforated plate for return air intake.

Applications

Both air outlets can be used in all areas of industry, research and medicine where air cleanliness to the above-mentioned cleanliness classes is required (see chart on page 9).

Puridrall and Puri-inlet are well suited for refitting existing HVAC systems in clean rooms.

Construction design

Puridrall

Puridrall is available in 7 sizes, for a volume flow rate range of 20 to 450 l/s (75 to 1600 m³/h). Its essential components are the housing 1 with built-in HEPA filter cell 2 and twist outlet 3.

Attractive slim ceiling twist outlets are used for all Puridrall sizes.

The twist outlet is detachable downwards. Two different constructions are available to enable the HEPA filter cell replacement:

U construction: Filter cell replacement from below, from clean room.

O construction: Filter cell replacement from above, from false ceiling.

After releasing the contact pressure fixture 4 the filter cell 2 can be easily removed. In the U construction, the twist outlet or in the O construction the upper endplate 17 must be dismantled.

The sealing frame 5 for the filter cell is available with a test groove 5b (DIN 1946, Part 4) for dry sealing. The tightness test with the U construction is conducted from below with the twist outlet removed, and with the O construction from above, with the endplate detached at measurement point 6.

Instead of a dry sealing, the filter cells for housing sizes 1 to 6 are available with fluid sealing 2c. They have a groove with fluid filling in the segment of the cell frame. In this option, the sealing frame 5 is fitted with a surrounding knife edge 5a which immerses in the fluid filling to make an airtight connection.

The air-side connection can be made either via a lateral, rectangular connection spigot 8 with a connection flange, or from above with a circular connection spigot. An airtight shutoff damper 9 with either an electric or pneumatic servomotor 10 can be built into the connection spigot. Depending on the housing construction (U or O), the servomotor is accessible from below or above. Strap fasteners 14 are used for ceiling attachment.

Puri-inlet

The construction design is the same as for Puridrall but a perforated plate is used instead of the twist outlet element.

Materials and types

Housing, connection spigot, sealing frame and knife edge made of galvanized sheet metal, coated on both sides with disinfectant-proof epoxy polyester resin, colour to RAL 7035 (light grey). Contact pressure fixture, holder for crossbeam and test pipe for tight fit and filter pressure made of stainless steel.

Twist outlet and perforated plate made of galvanized sheet metal, coating with disinfectant-proof epoxy polyester resin, colour to RAL 9010 (pure white) or as required.

Class H13 or H14 HEPA filter cell (to DIN EN 1822-1), filter cell frame made of aluminium,

Filter cell frame with handles on the extraction side for filter cell replacement from above.

Cell frame with polydimethyl siloxene fluid sealing


Properties: liquid, colourless, odourless

Density: 0.97 g/cm³ at 20°C

Thermal decomposition: ≥ 200°C

All parts are made of rustproof material or protected from corrosion, and are disinfectant-resistant.

U construction: Filter cell replacement from below

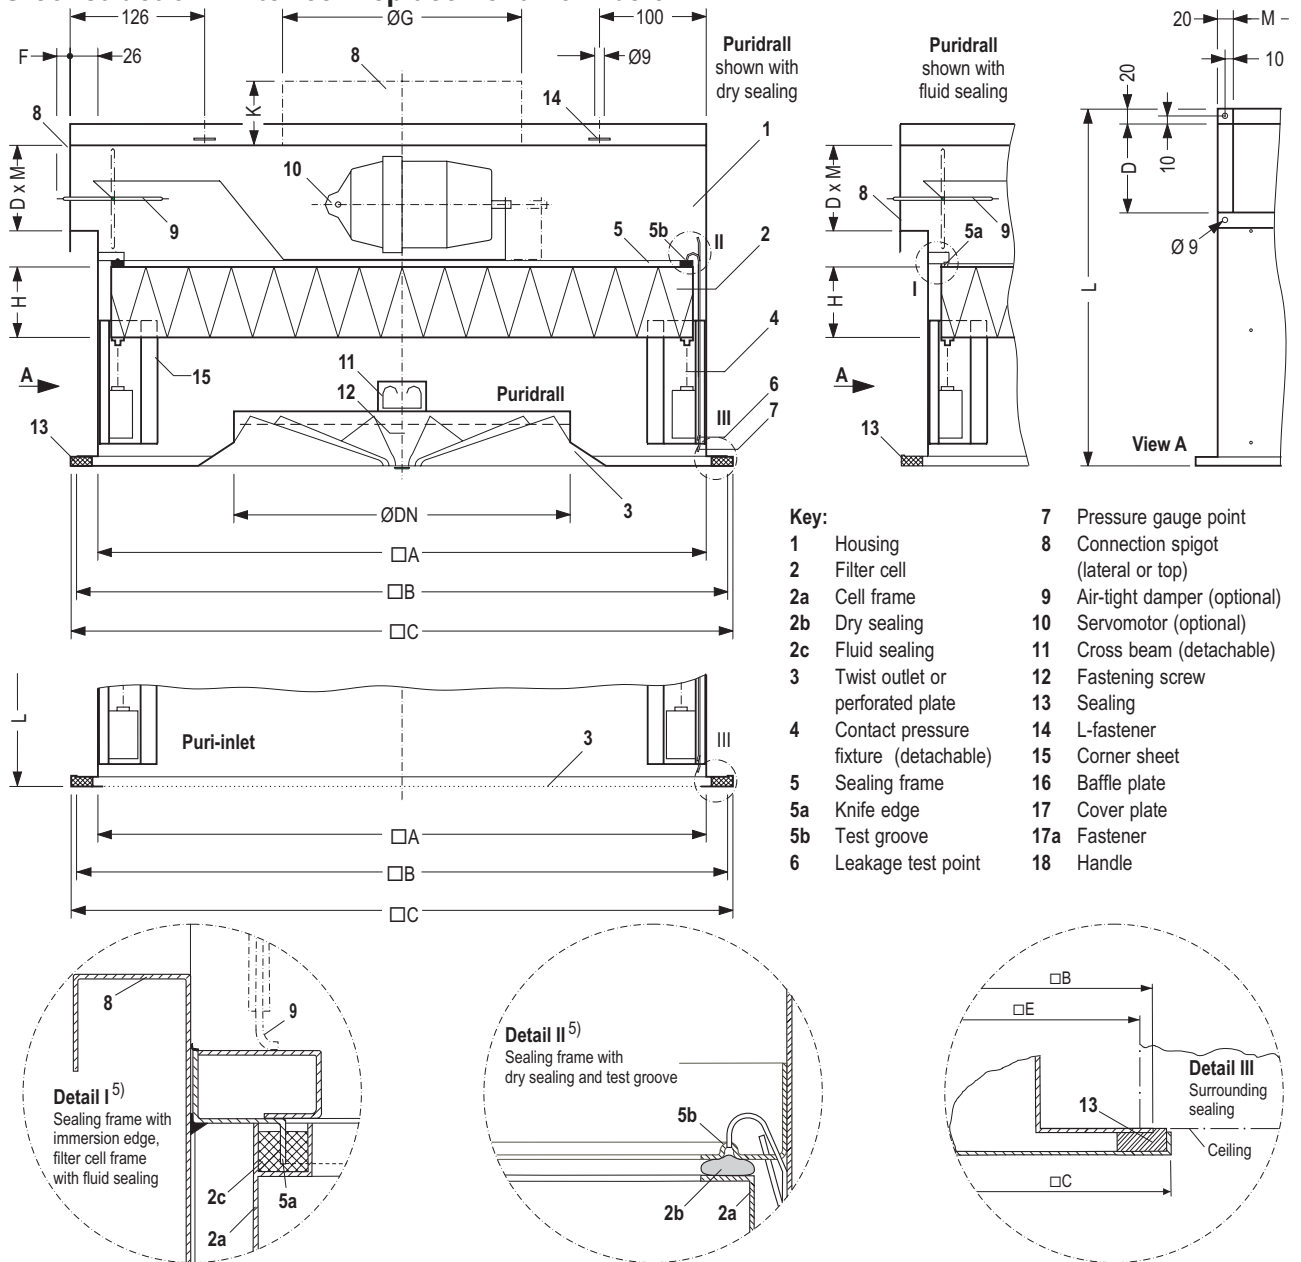


	Housing size	Twist outlet size (Type RA-N) ⁶⁾	Filter cell L x B x H ⁴⁾ mm	Volume flow rate						Pressure loss ¹⁾			Dimensions										Total weight approx. kg
				\dot{V}_{max} l/s	\dot{V}_{max} m ³ /h	\dot{V}_{min} l/s	\dot{V}_{min} m ³ /h	\dot{V}_{nenn} l/s	\dot{V}_{nenn} m ³ /h	u_{nenn} m/s	Δp_{nom} Pa	$\Delta p_{t nom}$ Pa	□A mm	□B mm	□C mm	D mm	□E mm	L mm	F mm	Ø-G mm	K mm	M mm	
Puridrall	PD - 1	DN 180	305 x 305 x 66	55	200	20	75	40	150	0.45	160	185	330	380	390	80	363	320	13	149	40	292	12
	PD - 2	DN 250	457 x 457 x 66	110	400	38	140	95	340	0.45	160	180	482	532	542	80	515	320	13	199	40	444	18
	PD - 3	DN 315	457 x 457 x 66	125	450	55	200	95	340	0.45	160	175	482	532	542	80	515	320	13	199	40	444	18
	PD - 4	DN 315	545 x 545 x 66	165	600	55	200	135	480	0.45	160	190	570	610	620	80	600	320	13	224	60	532	24
	PD - 5	DN 355	610 x 610 x 66	195	700	85	300	170	605	0.45	155	170	635	685	695	80	668	320	13	249	60	597	27
	PD - 6	DN 400	610 x 610 x 90	250	900	110	400	225	805	0.60	155	170	635	685	695	80	668	320	13	279	60	597	28
	PD - 7	DN 500	610 x 610 x 110	445	1600	195	700	335	1205	0.90	155	175	635	685	695	160	668	435	53	399	80	597	37
Puri-inlet	PE - 1	—	305 x 305 x 66	55	200	—	—	40	150	0.45	160	180	330	380	390	80	363	320	12	149	40	292	11.5
	PE - 2	—	457 x 457 x 66	125	450	—	—	95	340	0.45	160	175	482	532	542	80	515	320	13	199	40	444	17.5
	PE - 4	—	545 x 545 x 66	165	600	—	—	135	480	0.45	160	170	570	610	620	80	600	320	13	224	60	532	23.5
	PE - 5	—	610 x 610 x 90	280	1000	—	—	225	805	0.60	155	165	635	685	695	80	668	320	13	249	60	597	26
	PE - 7	—	610 x 610 x 110	555	2000	—	—	335	1205	0.90	155	170	635	685	695	160	668	435	53	399	80	597	36

1) Initial pressure loss Δp -start (class H14 filter cell uncontaminated) at nominal volume flow rate \dot{V}_{nom}
 2) Recommendation: Filter replacement at Δp -end = 2 x Δp -start from chart on page 8, depending on selected volume flow rate
 3) Puridrall or Puri-inlet with filter cell
 4) Height H and pressure loss Δp_{nom} apply for our standard filter cells. Other heights and pressure losses apply for other filter cell makes and for filter cells with fluid sealing.

5) Shown for the option: Filter cell replacement from below
 6) Other outlet types available on request

O construction: Filter cell replacement from above

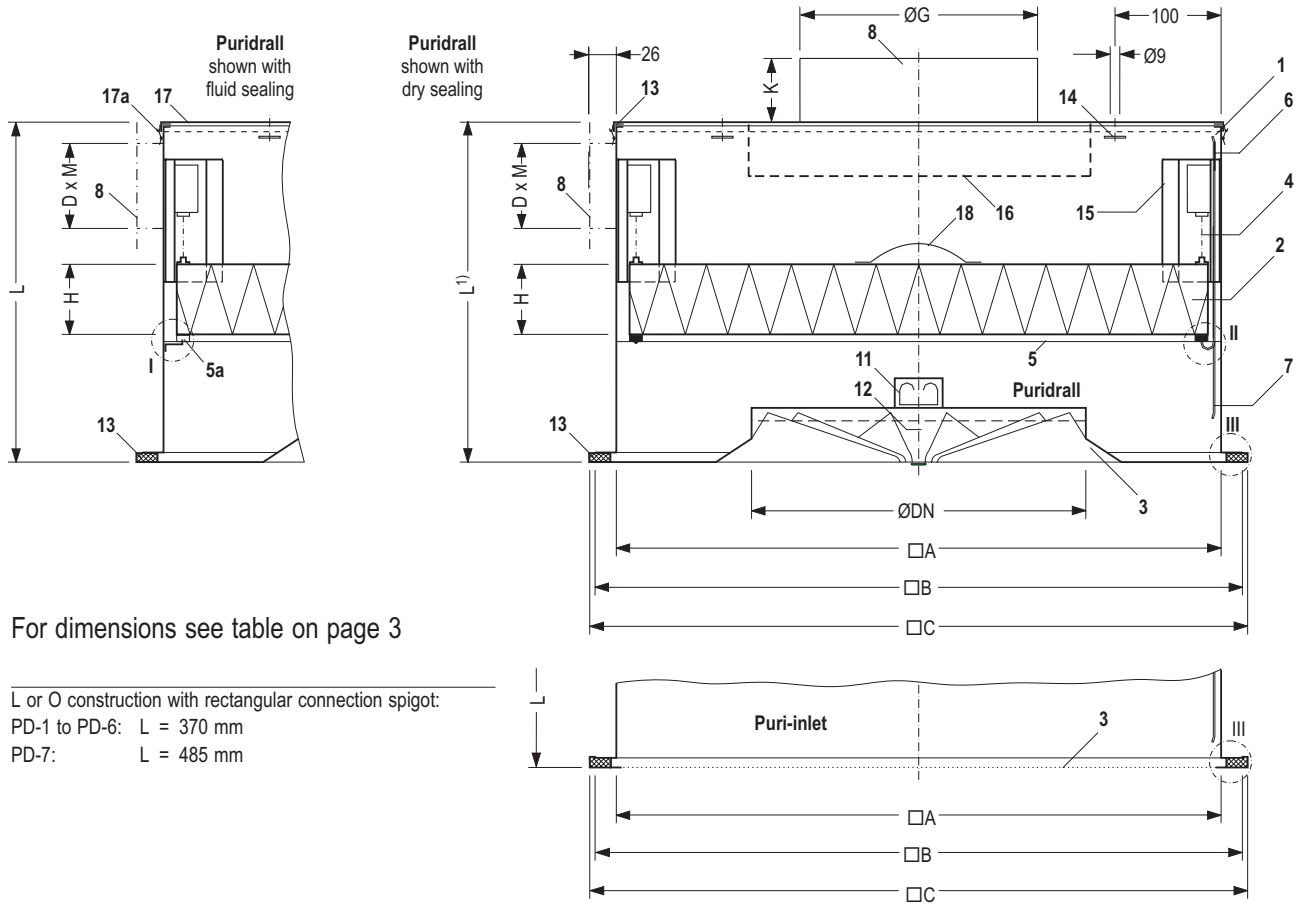


For dimensions see table on page 3

L or O construction with rectangular connection spigot:

PD-1 to PD-6: L = 370 mm

PD-7: L = 485 mm

Filter cell replacement from below

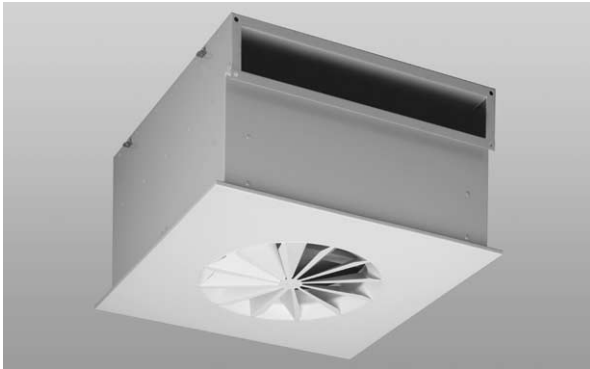

Puridral with rectangular connection spigot



Air outlet removed, filter cell and contact pressure fixture visible


Filter cell replacement from above



Puridral with circular connection spigot in the detachable cover plate



Cover plate removed, filter cell and contact pressure fixture visible

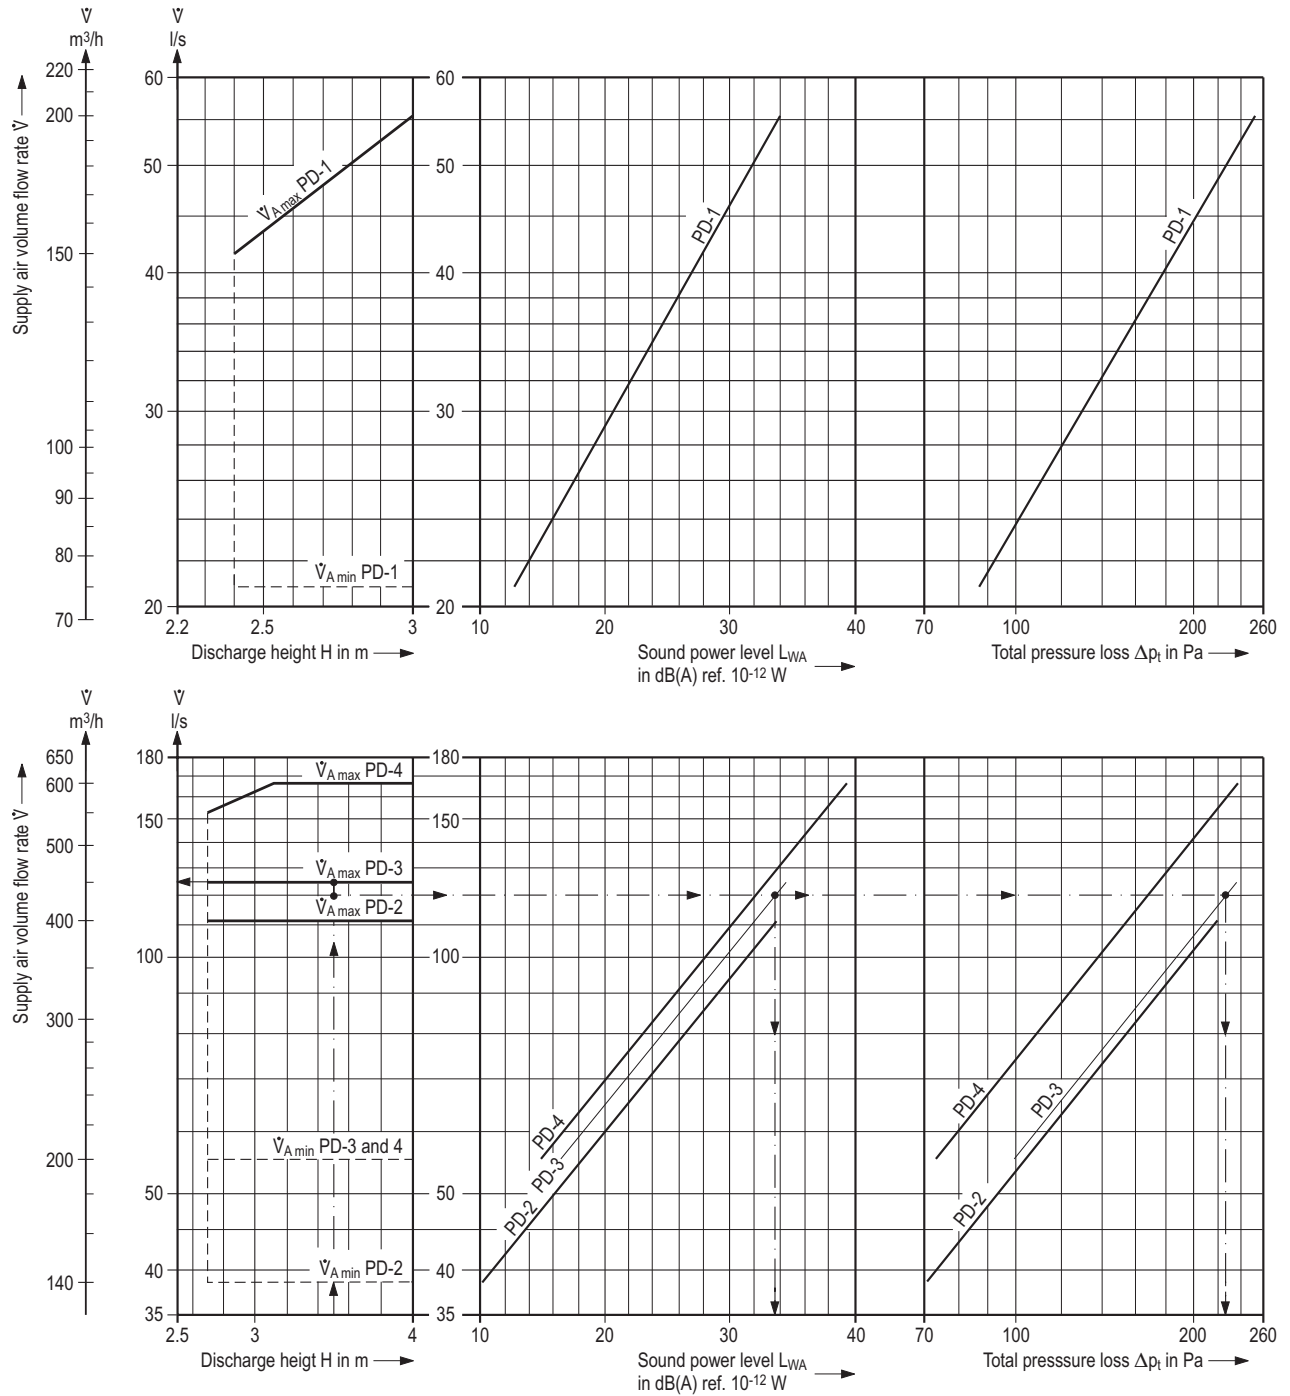

Layout example for Puridrall PD-3:



- 1 Supply air volume flow rate $\dot{V} = 5\,000 \text{ l/s}$
- 2 Discharge height $H = 3.5 \text{ m}$
- 3 Room area $A = 245 \text{ m}^2$
- 4 Specific volume flow rate $\dot{V}_{Sp} = 20.4 \text{ l/(s} \cdot \text{m}^2)$ (① : ③)
- 5 Max. perm. sound power level $L_{WA} = 35 \text{ dB(A)}$ ref. 10^{-12} W

From chart:

- 6 $\dot{V}_{A \max} = 125 \text{ l/s}$
- 7 \dot{V}_A selected = 120 l/s and hence
- 8 $Z = 42$ units from (① : ⑦)
- 9 $L_{WA} \approx 33 \text{ dB(A)}$ ref. 10^{-12} W
- 10 $\Delta p_t \approx 225 \text{ Pa}$
- 11 $t_{\min} \approx 2.4 \text{ m}$ (Chart page 7)

Key:

- \dot{V} = Total supply air volume flow rate
- $\dot{V}_{A \max}$ = Max. volume flow rate per Puridrall depending on discharge height (outlet to floor)
- $\dot{V}_{A \text{ sel.}}$ = Selected volume flow rate per outlet
- H = Discharge height
- Δp_t = Total pressure loss of Puridrall with uncontaminated filter cell
- t_{\min} = Minimum Puridrall spacing
- \dot{V}_{Sp} = Specific air volume flow rate per m^2 of room area

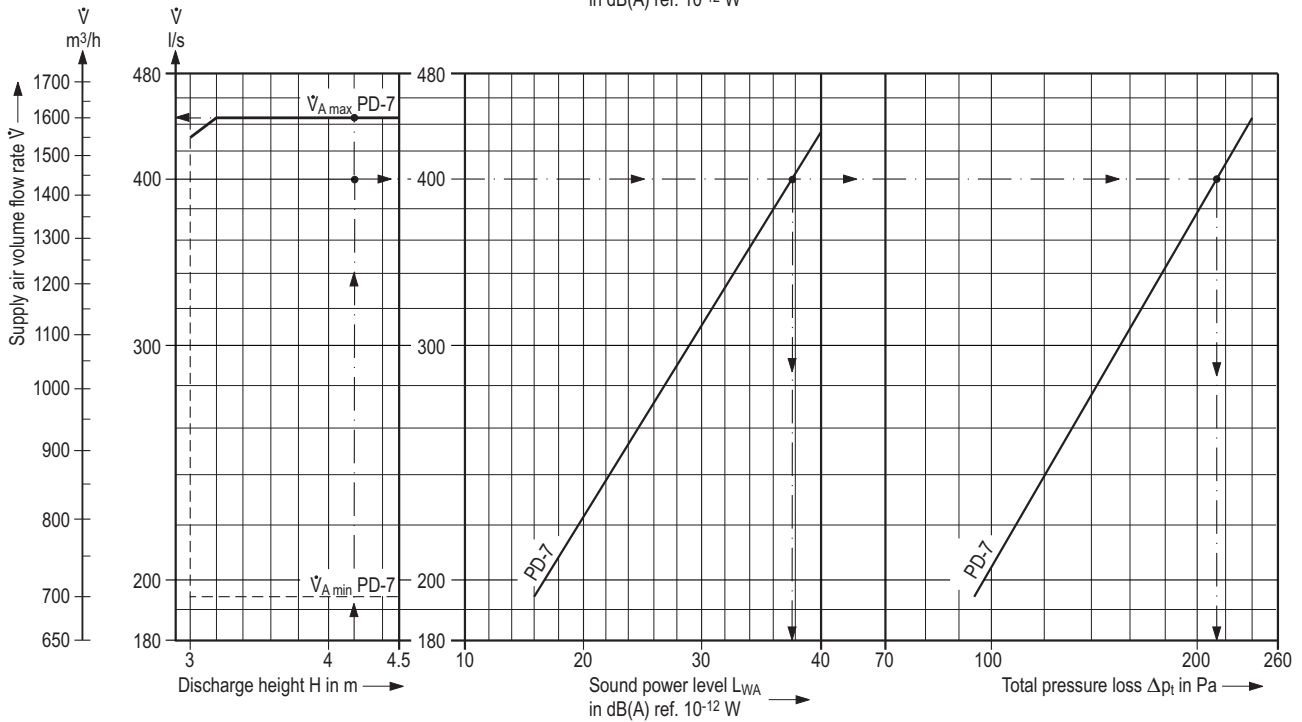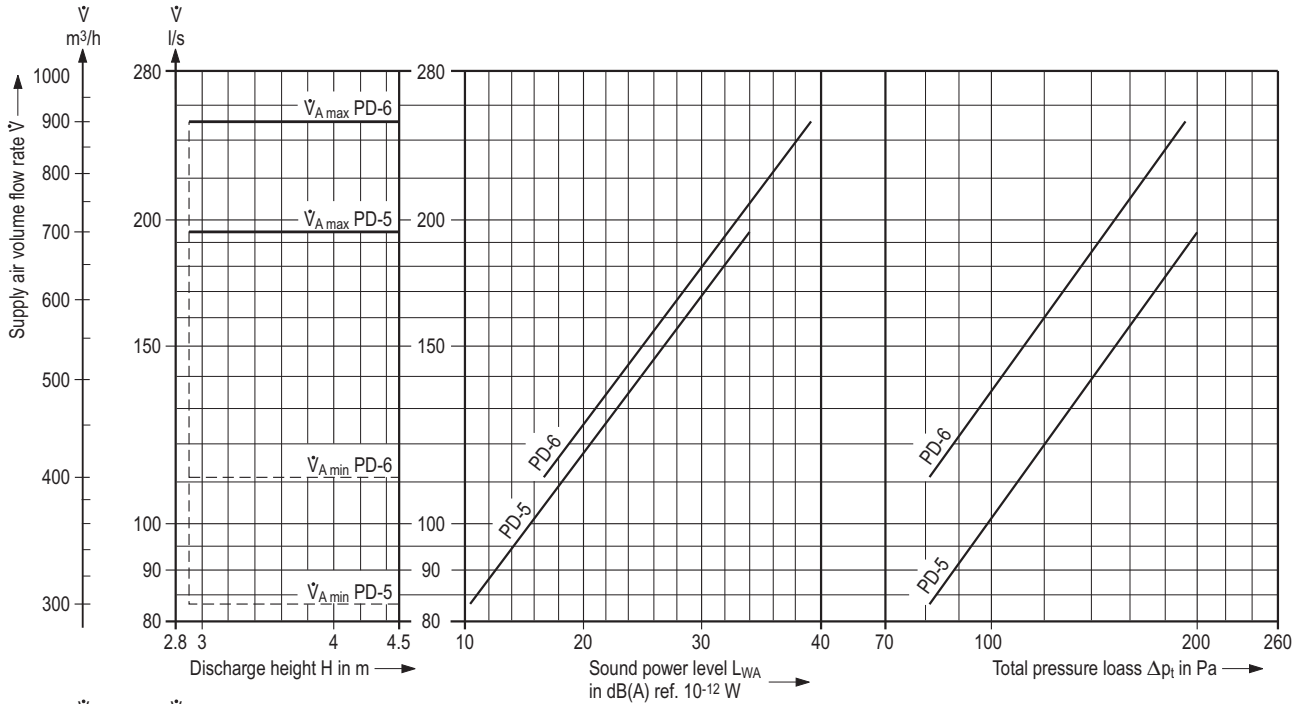

Layout example for Puridral PD-7:

- 1 Supply air volume flow rate $\dot{V} = 9\,700 \text{ l/s}$
- 2 Discharge height $H = 4.2 \text{ m}$
- 3 Room area $A = 415 \text{ m}^2$
- 4 Specific volume flow rate $\dot{V}_{Sp} = 23.4 \text{ l/(s} \cdot \text{m}^2)$ (① : ③)
- 5 Max. perm. sound power level $L_{WA} = 40 \text{ dB(A)}$ ref. 10^{-12} W

From chart:

- 6 $\dot{V}_{A \max} = 444 \text{ l/s}$
- 7 \dot{V}_A selected = 400 l/s and hence
- 8 $Z = 24$ units from (① : ⑦)
- 9 $L_{WA} \approx 38 \text{ dB(A)}$ ref. 10^{-12} W
- 10 $\Delta p_t \approx 215 \text{ Pa}$
- 11 $t_{\min} \approx 4.15 \text{ m}$ (Chart page 7)


Key:

- \dot{V} = Total supply air volume flow rate
- $\dot{V}_{A \max}$ = Max. volume flow rate per Puridral depending on discharge height (outlet to floor)
- $\dot{V}_{A \text{ sel.}}$ = Selected volume flow rate per outlet
- H = Discharge height
- Δp_t = Total pressure loss of Puridral with uncontaminated filter cell
- t_{\min} = Minimum Puridral spacing
- \dot{V}_{Sp} = Specific air volume flow rate per m^2 of room area

Total pressure loss and sound power level for Puridrall

Puridrall housing size	Outlet volume flow rate		Total pressure loss Δp_t Pa	L_{WA} dB(A)	Sound power level L_W in dB ref. 10^{-12} W						
	\dot{V} l/s	\dot{V} m ³ /h			Octave band centre frequency in Hz						
					63	125	250	500	1000	2000	4000
PD - 1	22	80	93	14	17	21	16	14	—	—	—
	33	120	145	23	26	30	25	23	16	—	—
	44	160	200	29	32	36	31	29	22	16	—
	55	200	250	34	37	41	36	34	27	21	—
PD - 2	55	200	105	18	27	28	20	14	—	—	—
	70	250	135	23	32	33	25	19	14	—	—
	85	300	160	27	36	37	29	23	18	17	16
	110	400	220	34	43	44	36	30	25	24	23
PD - 3	85	300	153	26	36	37	24	18	19	15	15
	97	350	180	29	40	40	28	22	23	18	19
	110	400	210	32	43	43	31	25	26	21	22
	125	450	232	34	45	46	33	27	28	24	24
PD - 4	85	300	112	24	29	32	22	17	16	17	17
	110	400	152	31	35	38	28	23	23	23	23
	140	500	195	35	40	43	33	28	28	28	28
	165	600	235	39	44	47	37	32	31	32	32
PD - 5	110	400	110	18	31	31	19	—	—	—	—
	140	500	140	25	38	37	25	18	—	—	—
	165	600	170	30	43	42	30	23	17	—	—
	195	700	200	34	47	47	35	28	21	18	16
PD - 6	165	600	125	28	35	35	30	25	23	17	—
	195	700	148	32	39	39	34	29	27	21	—
	220	800	170	36	43	43	38	33	31	25	17
	250	900	190	39	46	46	41	36	34	28	20
PD - 7	280	1000	141	27	35	36	31	25	18	—	—
	335	1200	174	32	40	41	36	30	23	—	—
	390	1400	208	37	45	46	41	35	28	19	—
	445	1600	240	41	49	50	45	39	32	23	17

Minimum Puridrall spacing

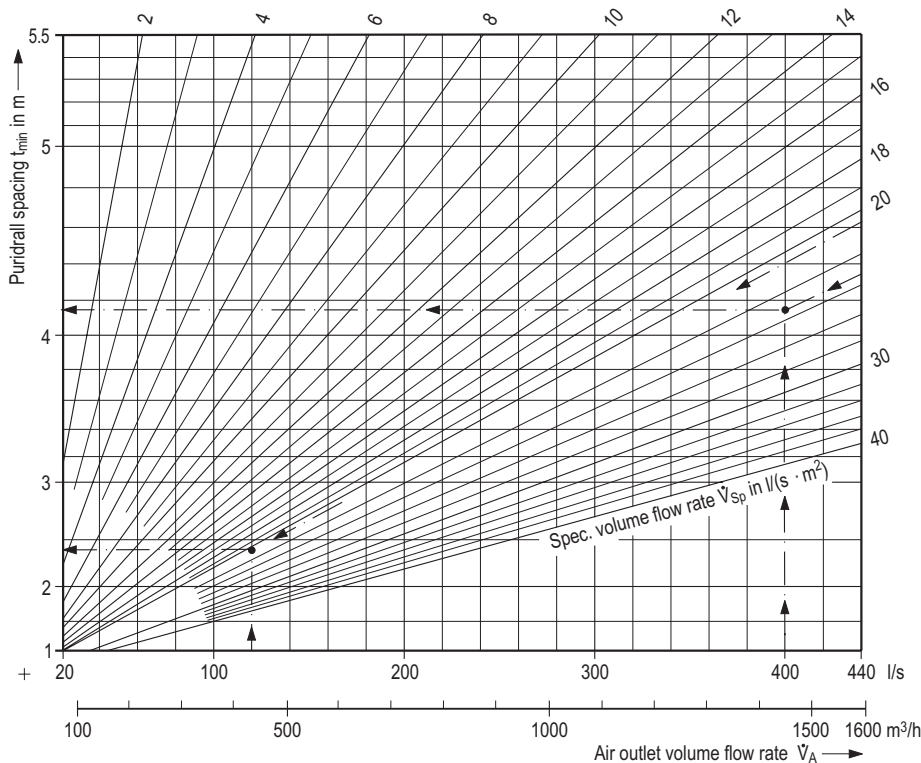

1. Example Puridrall PD-3 (see page 5)

Air outlet volume flow rate $\dot{V}_A = 120$ l/s

Specific volume flow rate $\dot{V}_{Sp} = 20.4$ l/(s · m²)¹⁾

Min. Puridrall spacing $t_{min} \approx 2.4$ m²⁾

2. Example Puridrall PD-7 (see page 6)

Air outlet volume flow rate $\dot{V}_A = 400$ l/s


Specific volume flow rate $\dot{V}_{Sp} = 23.4$ l/(s · m²)¹⁾

Min. Puridrall spacing $t_{min} \approx 4.15$ m²⁾

1) Related to floor area


2) When the Puridrall outlets are unevenly spaced the t_{min} selected can be max. 25% smaller

Pressure loss of class H14 ¹⁾ HEPA filter

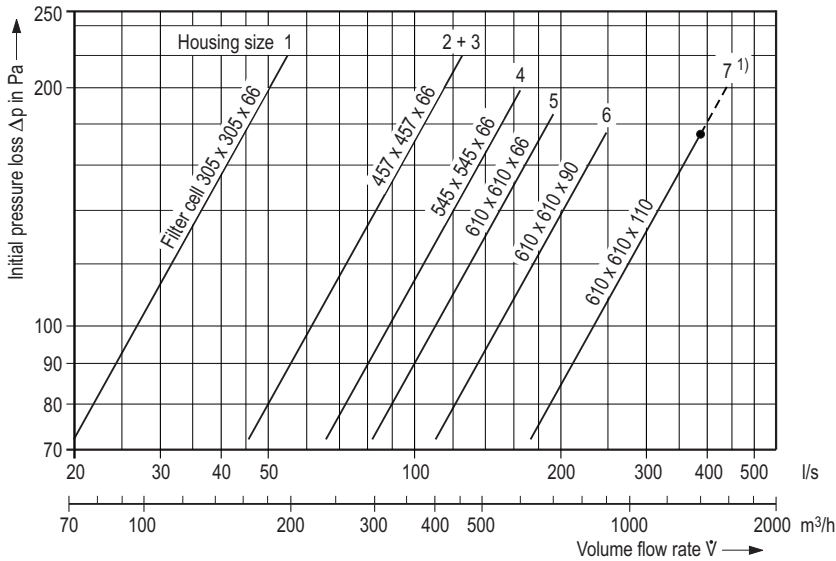

1) Housing size 7: Volume flow rate > 1400 m³/h corresponds to class H13

Puri-inlet

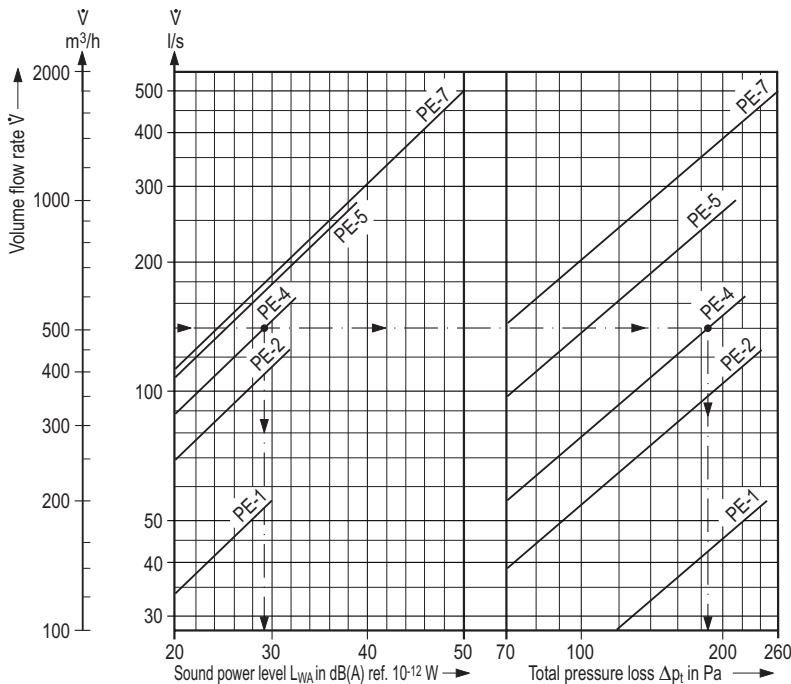

Layout example for Puri-inlet:

- 1 Return air volume flow rate \dot{V} = 6945 l/s
- 2 Max. permitted sound power level L_{WA} = 35 dB(A) ref. 10⁻¹² W


From chart:

- 3 Selected Puri-inlet = PE-4
- 4 Volume flow rate per inlet = 140 l/s
- 5 Number of Puri-inlet = 50 units
from (1) : (4)
- 6 Sound power level L_{WA} ≈ 29 dB(A) ref. 10⁻¹² W
- 7 Pressure loss Δp_t = 185 Pa


Total pressure loss and sound power level for Puri-inlet

Puri-inlet housing size	Volume flow rate		Total pressure loss Δp_t Pa	L_{WA} dB(A)	Sound power level L_W in dB ref. 10 ⁻¹² W						
	\dot{V} l/s	\dot{V} m ³ /h			Octave band centre frequency in Hz						
					63	125	250	500	1000	2000	4000
PE - 1	28	100	120	16	20	26	16	--	--	--	--
	40	150	182	24	28	34	24	21	17	--	--
	55	200	245	30	34	40	30	27	23	17	--
PE - 2	55	200	105	16	20	26	16	--	--	--	--
	85	300	155	24	28	34	24	21	17	--	--
	125	450	235	32	36	42	32	29	25	19	--
PE - 4	110	400	145	25	29	35	25	22	18	--	--
	140	500	180	29	33	39	29	26	22	16	--
	165	600	220	33	37	43	33	30	26	20	--
PE - 5	165	600	123	29	37	41	33	23	20	--	--
	220	800	165	35	43	47	39	29	26	20	--
	280	1000	205	39	47	51	43	33	30	24	15
PE - 7	280	1000	140	39	48	52	43	32	28	24	15
	415	1500	210	47	56	60	51	40	36	32	23
	555	2000	280	52	61	65	56	45	41	37	28

Cleanliness classes to DIN EN ISO 14644-1, US Federal Standard 209 and EG-GMP Guideline

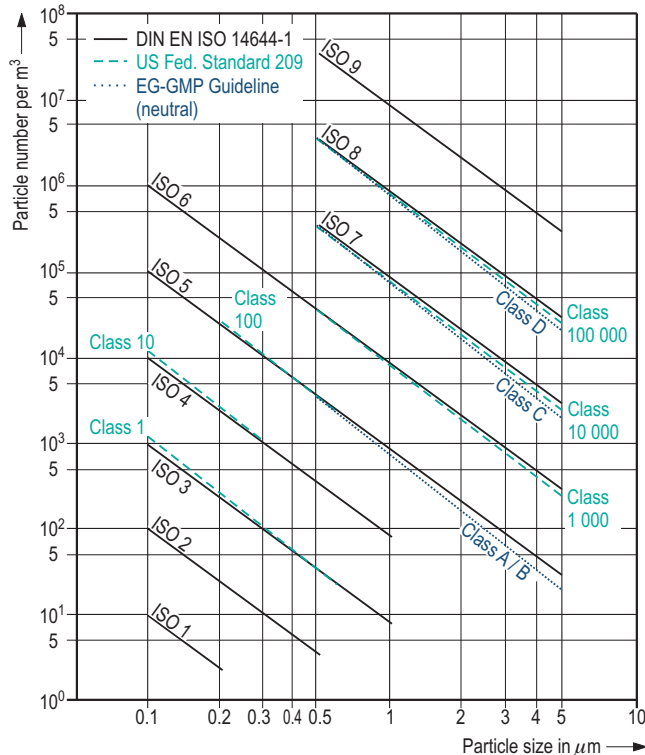

Type code

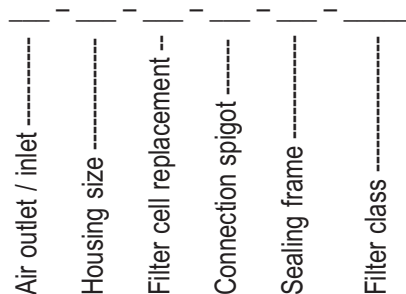

Air outlet / inlet:
PD = Puridrall;
PE = Puri-inlet

Housing size:
1 to 7

Filter cell replacement:

U = from below O = from above

Connection spigot:

E = Square, lateral
R = Circular, above
EE = Square, lateral with electric spring-return motor
EP = Square, lateral with pneumatic servomotor

Sealing frame:

T = Dry sealing; F = Fluid sealing

Filter class to DIN EN 1822-1: H13 or H14

Example:

Puridrall, housing size PD-4, filter cell replacement from below, with lateral square connection spigot, fluid sealing, filter class H14:

Type PD - 4 - U - E - F - H14

Puri-inlet, housing size PE-5, filter cell replacement from above, with circular connection spigot, dry sealing, filter class H13:

Type PE - 5 - O - R - T - H13

Features

- For cleanliness classes 6 to 8 to DIN EN ISO 14644-1 (VDI 2083) or 1 000 to 100 000 to US Federal Standard 209 as well as C and D to EG-GMP
- As **Puridrall** for air supply with twist outlet (Type RA-N) for horizontal, radial air discharge and for generating high-induction, turbulent mixing-air flow
- Even dilution of pollutants emitted in room
- As **Puri-inlet** for air filtering directly at the collection point, with perforated plate for air intake
- Air-tight housing to DIN 25414; max. leakage volume flow rate well below 0.003% of nominal volume flow rate at a pressure differential of 2000 Pa
- Optional construction for filter cell replacement from below (from room) or from above (from plenum)
- HEPA filter cell, type tested to DIN EN 1822-1, filter class H13 or H14 (optional)
- Filter cell frame with dry sealing or fluid sealing (for housing sizes 1 to 6)
- Filter cell frame with handles on the extraction side for filter cell replacement from above
- Filter sealing frame for dry sealing with connection for pressure differential measurement, particle sampling and leakage testing to DIN 1946, Part 4
- Filter sealing frame for fluid sealing (gel seal) with knife edge, pressure differential measurement, particle sampling; leakage testing not required
- Compact construction with easy accessibility for disinfection and maintenance work
- Low pressure loss and low sound power level
- Air connection lateral or from above, lateral also with air-tight shutoff damper (optional)
- With electric or pneumatic servomotor (optional)
- All parts rustproof or protected against corrosion
- Well suited for refitting existing HVAC systems in clean rooms

Tender text

..... units

Puridrall, air outlet for clean rooms, with twist outlet for turbulent mixing-air flow and strong induction effect between supply air and indoor air, easily detachable from room,

suitable for clean rooms of classes 6 to 8 to DIN EN ISO 14644-1 or 1 000 to 100 000 to US Federal Standard 209 as well as C and D to EG-GMP,

Puri-inlet, for filtering return air from clean rooms directly at the collection point, with perforated plate for air intake,

filter cell replacement from below from above

also consisting of:

air-tight housing with contact pressure fixture for the filter cell and

square connection spigot, lateral, with built-in air-tight shutoff damper.

Damper actuation by

electric spring-return motor,

pneumatic servomotor,

Damper de-energized "open". "closed".

Circular connection spigot, above.

Sealing frame for dry sealing with surrounding test groove for leakage test to DIN 1946, Part 4.

Sealing frame for fluid sealing (gel seal), with surrounding knife edge.

Measurement point for pressure differential as well as particle sampling on the untreated air side.

HEPA filter cell, cell frame including

dry sealing.

fluid sealing. ¹⁾

Technical data:

Volume flow rate: l/s (m³/h)

Filter class: H13
 H14¹⁾

Perm. sound power level: dB(A) ref. 10⁻¹² W

Total pressure loss with uncontaminated filter cell Pa

Materials:

Housing, twist outlet, perforated plate,

contact pressure frame and sealing frame:

Galvanized sheet metal

Filter cell frame:

Aluminium

Surface protection:

Housing, twist outlet

and contact pressure frame:

Epoxy polyester resin coating, disinfectant-proof

Colour

– housing:

RAL 7035 (light grey)

– square visible surface

incl. air outlet / inlet:

RAL 9010 (pure white) or

RAL

Dimensions:

Housing LxWxH: mm x mm x mm

Filter cell LxWxH: mm x mm x mm

Weight with filter cell:

..... kg

Make:

KRANTZ KOMPONENTEN

Type:

___ - ___ - ___ - ___ - ___

Subject to technical alterations!

1) Available for sizes 1-6 and size up to 1400 m³/h;
size 7 > 1400 m³/h corresponds to class H13